

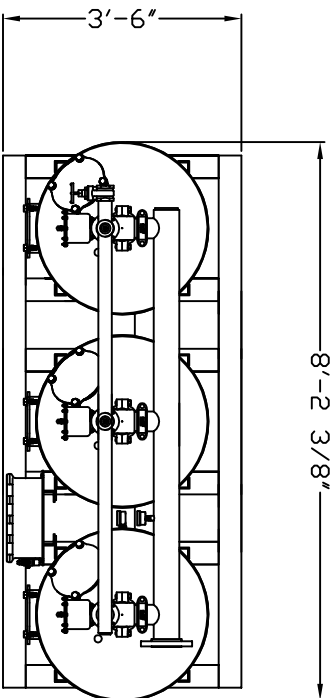


GAC 3072-3A

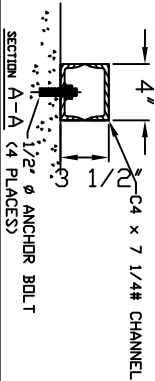

- NOTES:
1. FLOW RATE DESIGN: 75-150 GPM, MAX TD 270 GPM.
 2. MAXIMUM WORKING PRESSURE: 100 PSI.
 3. ELECTRICAL REQUIREMENTS:
CONTROLLER 120V,
SOLENOIDS 24VAC, FACTORY WIRED
 4. AIR SUPPLY REQUIRED: 2 CFM @ 70 PSIG (MIN).
 5. MEDIA REQUIREMENT PER TANK:
A. 1/2"x3/4" CRUSHED ROCK: 2.5 CU. FT.
B. GRANULAR ACTIVATED CARBON: 19.5 CU. FT.
 6. WEIGHTS: (APPROX.)
EQUIPMENT: 1,920 LBS (LESS MEDIA)
MEDIA: 2,447 LBS
OPERATION: 7,850 LBS

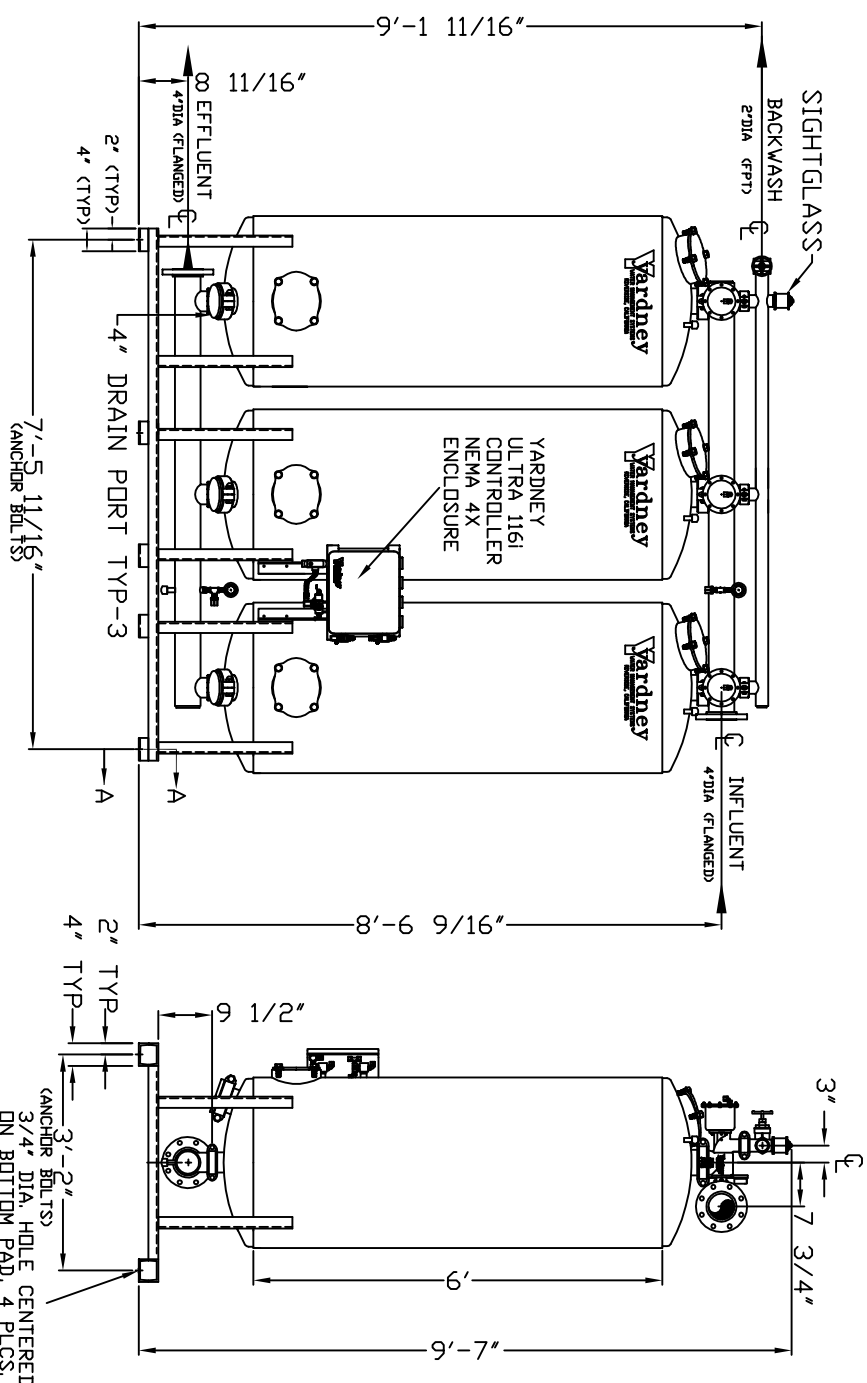

<p>FOR THE RECORD, THE DESIGNER'S RESPONSIBILITY IS LIMITED TO THE DESIGN OF THE FILTER SYSTEM. THE USER OF THIS DESIGN SHALL BE RESPONSIBLE FOR THE PROPER INSTALLATION AND MAINTENANCE OF THE SYSTEM. THE USER SHALL BE RESPONSIBLE FOR THE PROPER SELECTION OF THE MEDIA AND THE PROPER SELECTION OF THE CONTROLLER AND THE PROPER SELECTION OF THE AIR SUPPLY. THE USER SHALL BE RESPONSIBLE FOR THE PROPER SELECTION OF THE MEDIA AND THE PROPER SELECTION OF THE CONTROLLER AND THE PROPER SELECTION OF THE AIR SUPPLY.</p>		
REV	DATE	DESCRIPTION
A	07/15/20	ISSUED FOR PERMIT
B	07/15/20	REVISED PER COMMENTS
C	07/15/20	REVISED PER COMMENTS
D	07/15/20	REVISED PER COMMENTS
E	07/15/20	REVISED PER COMMENTS
F	07/15/20	REVISED PER COMMENTS
G	07/15/20	REVISED PER COMMENTS
H	07/15/20	REVISED PER COMMENTS
I	07/15/20	REVISED PER COMMENTS
J	07/15/20	REVISED PER COMMENTS
K	07/15/20	REVISED PER COMMENTS
L	07/15/20	REVISED PER COMMENTS
M	07/15/20	REVISED PER COMMENTS
N	07/15/20	REVISED PER COMMENTS
O	07/15/20	REVISED PER COMMENTS
P	07/15/20	REVISED PER COMMENTS
Q	07/15/20	REVISED PER COMMENTS
R	07/15/20	REVISED PER COMMENTS
S	07/15/20	REVISED PER COMMENTS
T	07/15/20	REVISED PER COMMENTS
U	07/15/20	REVISED PER COMMENTS
V	07/15/20	REVISED PER COMMENTS
W	07/15/20	REVISED PER COMMENTS
X	07/15/20	REVISED PER COMMENTS
Y	07/15/20	REVISED PER COMMENTS
Z	07/15/20	REVISED PER COMMENTS

Yardney
 WATER TREATMENT EQUIPMENT
 APPROVALS DATE: GAC 3072-3A
 FILTER SYSTEM
 SPEC. DRAWING NO. 9500307203
 REV. 1/20