
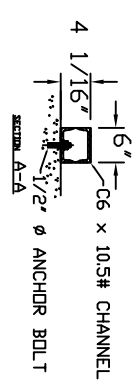


# GAC 4872-5A

**NOTES:**

1. FLOW RATE DESIGN: 315-630 GPM, MAX TO 1200 GPM.
2. MAXIMUM WORKING PRESSURE: 80 PSI
3. ELECTRICAL REQUIREMENTS:  
CONTROLLER 120V,  
SOLENOID 24VAC, FACTORY WIRED
4. AIR SUPPLY REQUIRED: 2 CFM @ 70 PSIG (MIN).
5. MEDIA REQUIREMENT PER TANK:  
A. 1/2"x3/4" CRUSHED ROCK: 7.0 CU. FT.  
B. GRANULAR ACTIVATED CARBON: 500 CU. FT.
6. WEIGHTS (APPROX.)  
EQUIPMENT: 6,500 LBS (LESS MEDIA)  
MEDIA: 10,775 LBS  
OPERATION: 33,800 LBS

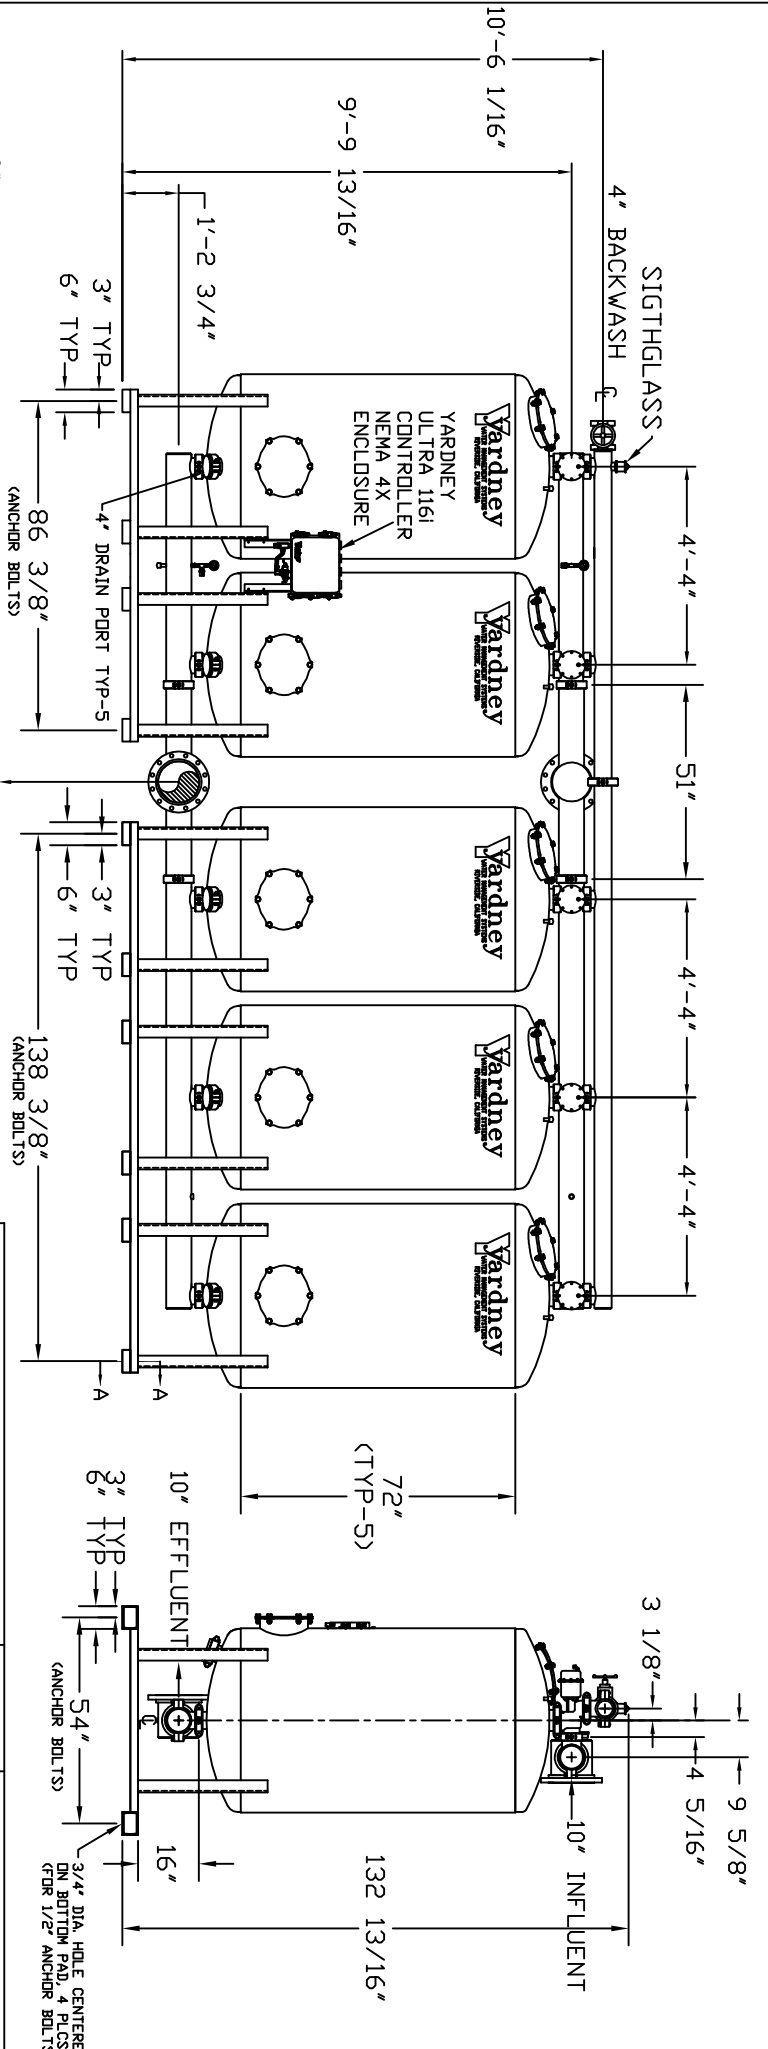

SECTION A-A  
4 1/16" ANCHOR BOLT (4 PLACES)

<p>THIS DRAWING INCLUDING THE INFORMATION IT CONTAINS IS CONFIDENTIAL PROPRIETARY AND IS THE PROPERTY OF YARDNEY WATER MANAGEMENT, INC. IT IS SUBMITTED ONLY IN CONNECTION WITH THE TRANSACTION TO WHICH IT PERTAINS AND MUST NOT BE USED IN ANY OTHER MANNER WITHOUT THE WRITTEN CONSENT AND MUST BE RETURNED UPON REQUEST. COPYRIGHT YARDNEY WATER MANAGEMENT SYSTEMS, 1994.</p>		
DATE	BY	DESCRIPTION
10-09	DTD	ADDED 4" DRAIN PORT
10-22-07	DTD	REVISION
<p>PROJECT NO. 9500487205</p>		<p>LOCATION: SYSTEMS\GAC</p>
<p>DATE: 10-22-07</p>		<p>REV: A</p>
<p>PROJECT: GAC 4872-5A</p>		<p>SHEET 1 OF 1</p>



**Yardney**  
WATER MANAGEMENT SYSTEMS